


Fish Processing Plant

The wastewater was received from a fish processing plant that utilizes water to float fish. Jar testing revealed that Floccin 1106 as the most effective product for treating the wastewater.

A 1,000 ml beaker filled with the water sample was used to conduct the treatability. 2 grams of Floccin 1106 were mixed in 1,000 ml of wastewater which equates to 16.7 lbs/1000 gallons. The results are pictured below.

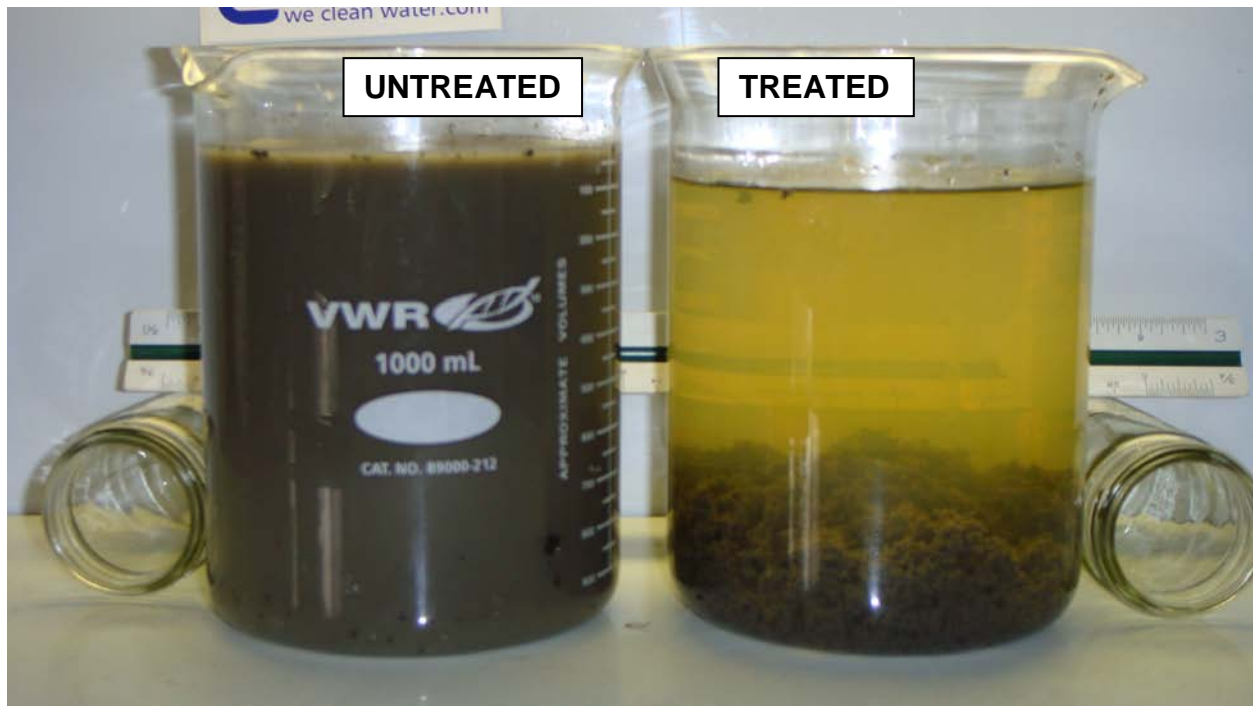

The facility would like to reuse the water which will require post hydrocarbon removal and ozonation subsequent to Floccin treatment.